


Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-27 00:00 - 2019-06-02 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_1
Location Fændediget 10
Sensor type C22
Serial no. 101687
Master(s) serial no. 101687
Latest calibration 2018-10-09
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.83 mm/s, L: 0.97 mm/s, T: 0.70 mm/s

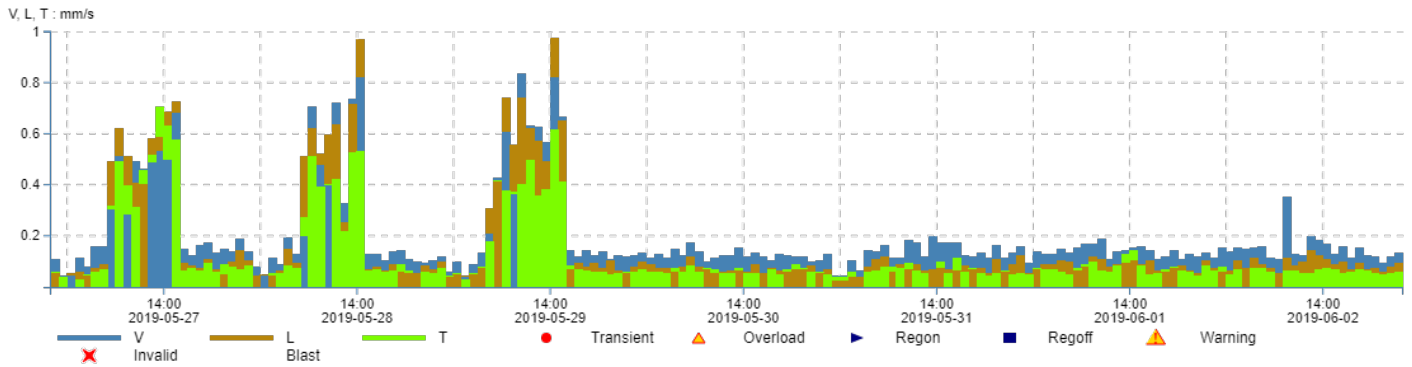

X-span 2019-05-27 00:00:00 - 2019-06-02 23:59:00

Y-span V, L, T : mm/s: 0.0 - 1.0


	V	L	T
Max	0.83 mm/s	0.97 mm/s	0.70 mm/s
Date	2019-05-29	2019-05-29	2019-05-27
Time	11:00:00	15:00:00	14:00:00

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-27 00:00 - 2019-06-02 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_2
Location Fændediget 12
Sensor type C22
Serial no. 101655
Master(s) serial no. 101655
Latest calibration 2018-10-09
Standard DIN4150-3 Anlag 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 5 sec
Frequency weighting OFF

Max V: 1.42 mm/s, L: 1.68 mm/s, T: 1.49 mm/s

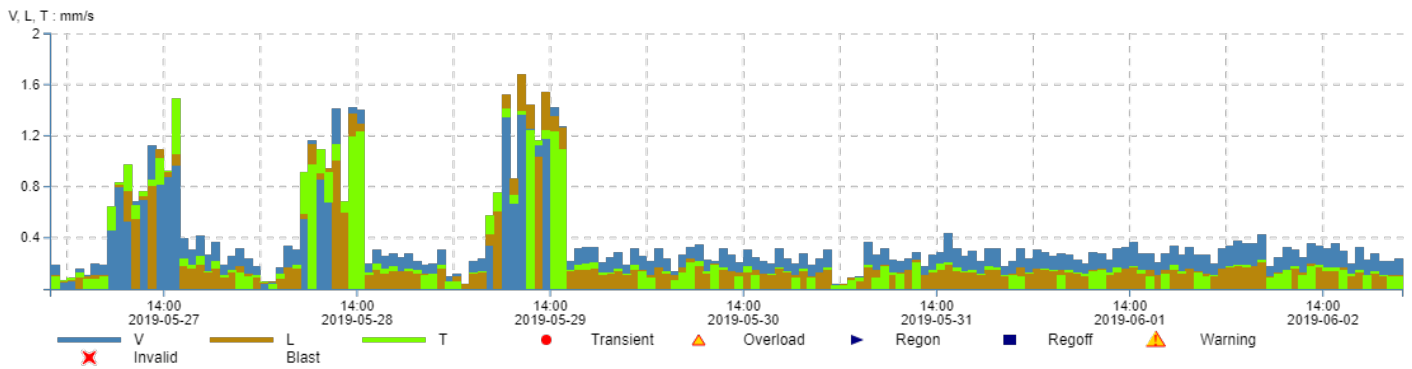

X-span 2019-05-27 00:00:00 - 2019-06-02 23:59:00

Y-span V, L, T : mm/s: 0.0 - 2.0


	V	L	T
Max	1.42 mm/s	1.68 mm/s	1.49 mm/s
Date	2019-05-28	2019-05-29	2019-05-27
Time	14:00:00	11:00:00	16:00:00

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-27 00:00 - 2019-06-02 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_3
Location Åvænget 21
Sensor type C22
Serial no. 101681
Master(s) serial no. 101681
Latest calibration 2018-10-08
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.39 mm/s, L: 0.94 mm/s, T: 0.35 mm/s

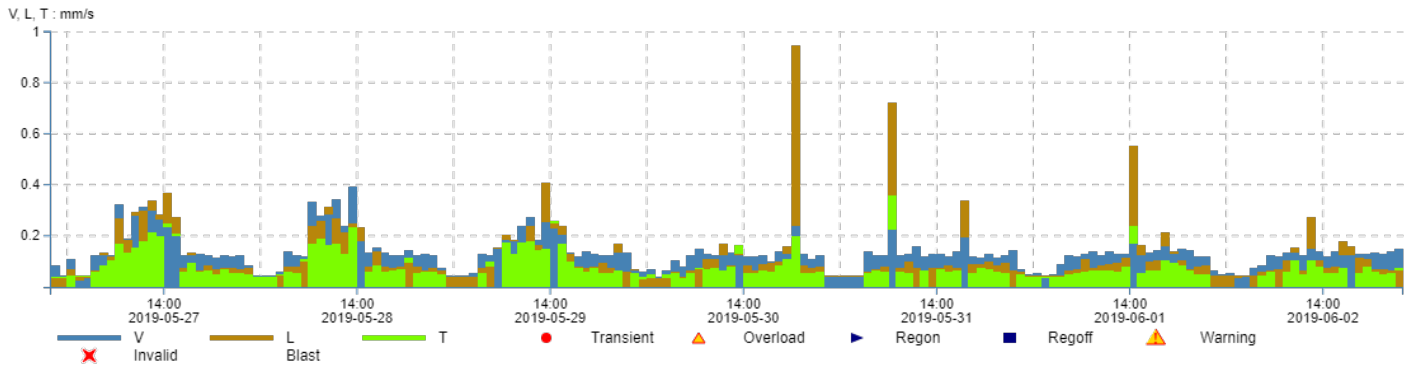

X-span 2019-05-27 00:00:00 - 2019-06-02 23:59:00

Y-span V, L, T : mm/s: 0.0 - 1.0


	V	L	T
Max	0.39 mm/s	0.94 mm/s	0.35 mm/s
Date	2019-05-28	2019-05-30	2019-05-31
Time	14:00:00	21:00:00	09:00:00

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-27 00:00 - 2019-06-02 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_4
Location Tolbodvej 11
Sensor type C22
Serial no. 101683
Master(s) serial no. 101683
Latest calibration 2018-10-08
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 5 sec
Frequency weighting OFF

Max V: 1.24 mm/s, L: 0.82 mm/s, T: 0.53 mm/s

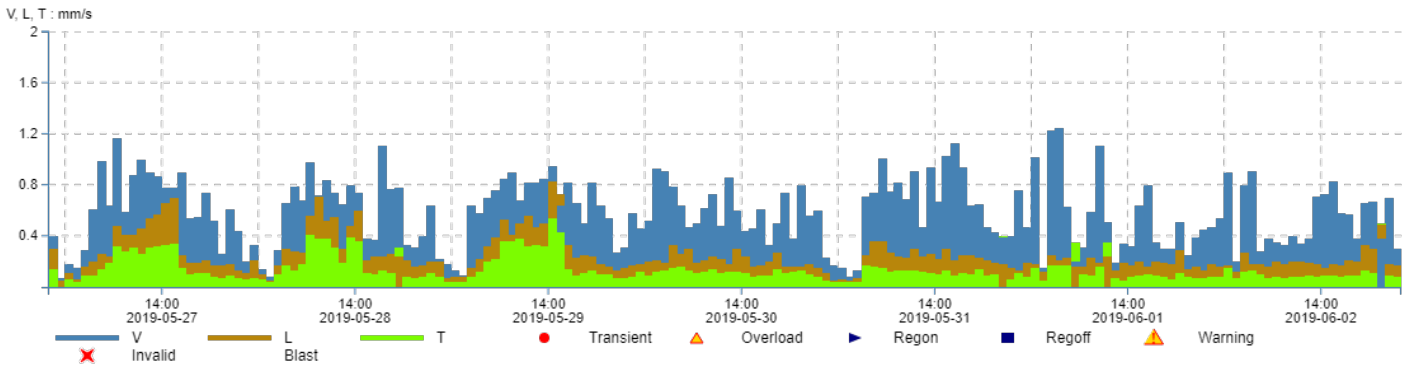

X-span 2019-05-27 00:00:00 - 2019-06-02 23:59:00

Y-span V, L, T : mm/s: 0.0 - 2.0


	V	L	T
Max	1.24 mm/s	0.82 mm/s	0.53 mm/s
Date	2019-06-01	2019-05-29	2019-05-29
Time	06:00:00	15:00:00	15:00:00

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-27 00:00 - 2019-06-02 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_5
Location Åvænget 29
Sensor type C22
Serial no. 101660
Master(s) serial no. 101660
Latest calibration 2018-10-09
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.20 mm/s, L: 0.22 mm/s, T: 0.40 mm/s

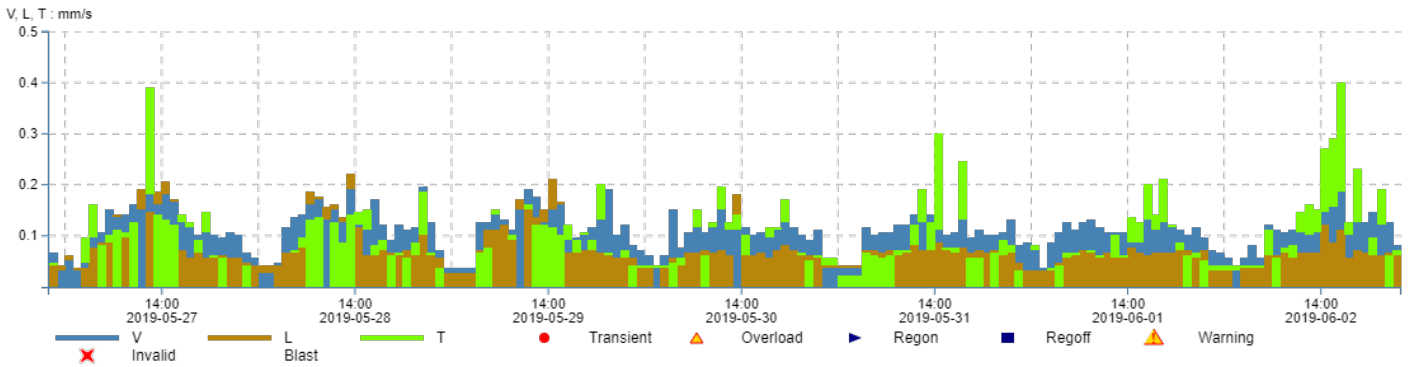

X-span 2019-05-27 00:00:00 - 2019-06-02 23:59:00

Y-span V, L, T : mm/s: 0.0 - 0.50


	V	L	T
Max	0.20 mm/s	0.22 mm/s	0.40 mm/s
Date	2019-05-28	2019-05-28	2019-06-02
Time	23:00:00	14:00:00	17:00:00

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-27 00:00 - 2019-06-02 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_6
Location Åvænget 25
Sensor type C22
Serial no. 101681
Master(s) serial no. 101681
Latest calibration 2018-10-08
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.39 mm/s, L: 0.94 mm/s, T: 0.35 mm/s

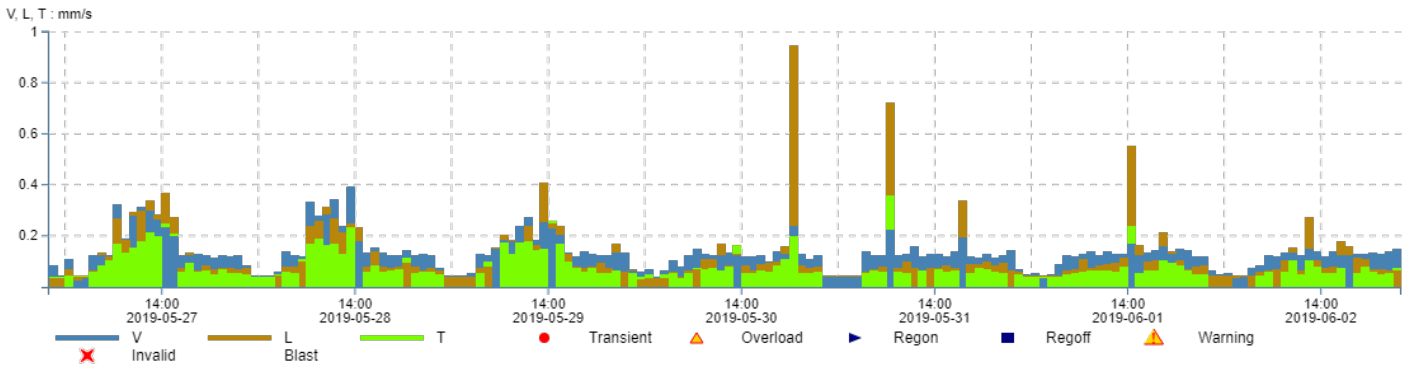

X-span 2019-05-27 00:00:00 - 2019-06-02 23:59:00

Y-span V, L, T : mm/s: 0.0 - 1.0

	V	L	T
Max	0.39 mm/s	0.94 mm/s	0.35 mm/s
Date	2019-05-28	2019-05-30	2019-05-31
Time	14:00:00	21:00:00	09:00:00